




## ESTIMATED EFFICIENCY SAVINGS

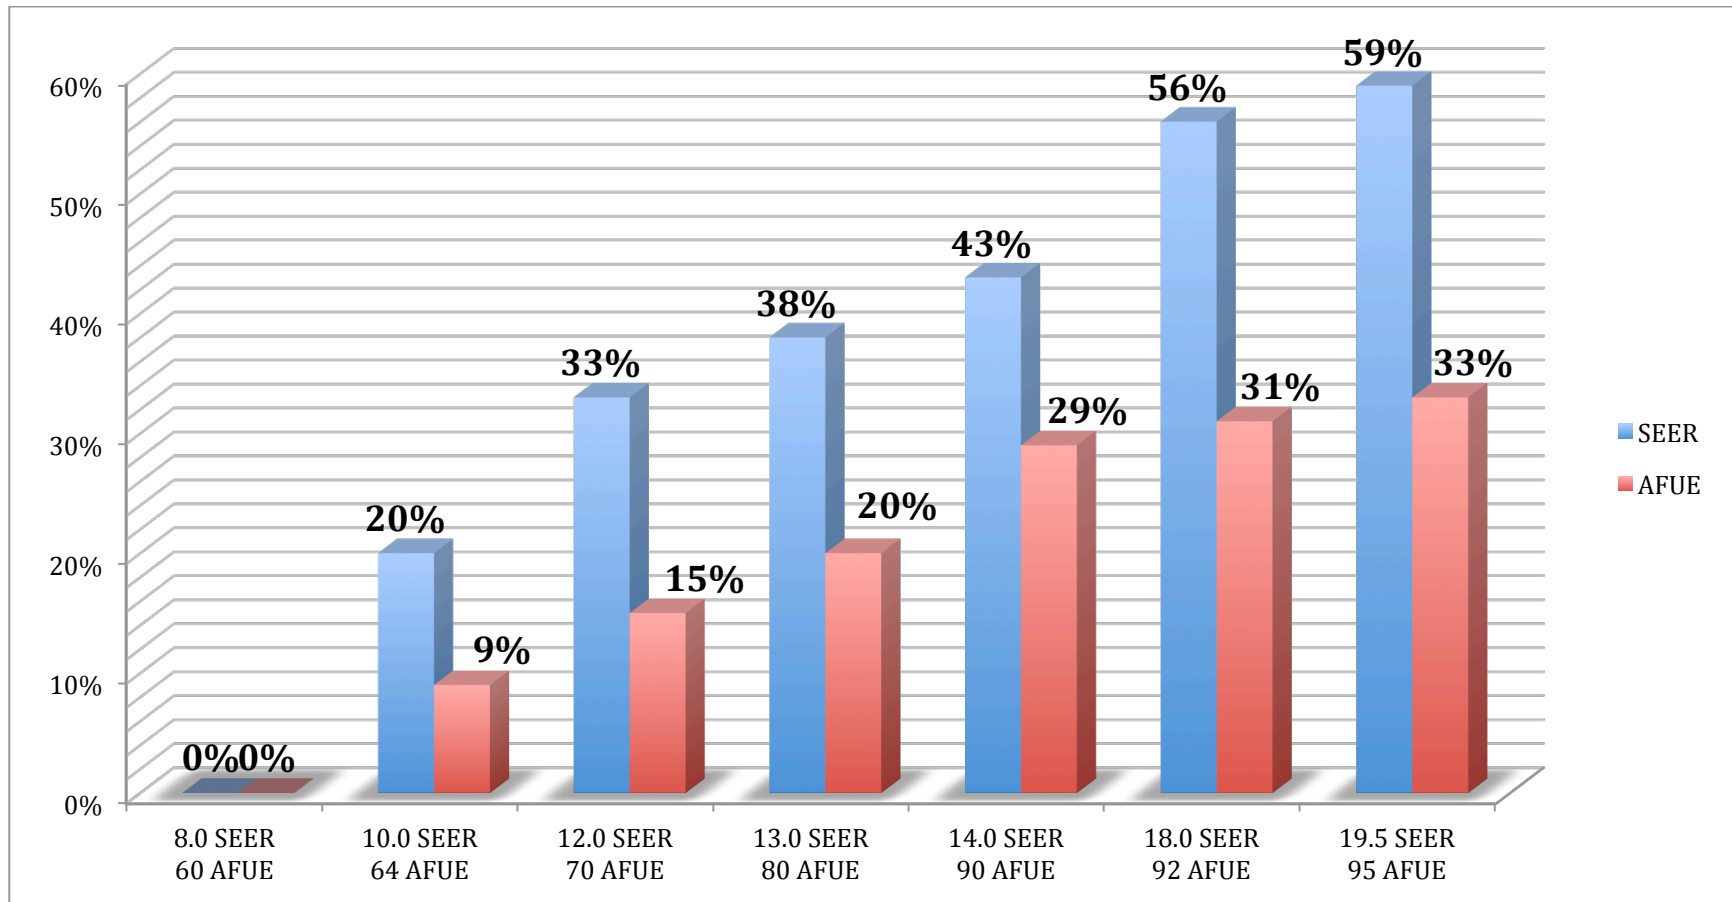

- *Seer - Performance Rating of Unitary Air-Conditioning and Air-Source Heat Pump Equipment*
- *AFUE - is a thermal efficiency measure of combustion equipment like furnaces, boilers, and water heaters.*
- *Minimum standards: 13 Seer/ 78% AFUE*